



中国国家强制性产品认证证书

证书编号: 2007010305230004

委托人名称、地址

PIZZATO ELETTRICA S. R. L.
Via Torino.1 36063 Marostica(VI), Italy

生产者(制造商)名称、地址

PIZZATO ELETTRICA S. R. L.
Via Torino.1 36063 Marostica(VI), Italy

生产企业名称、地址

PIZZATO ELETTRICA S. R. L.
Via Torino.2/A 36063 Marostica (VI), Italy

产品名称和系列、规格、型号

位置开关

FA, FB, FF;Ui:400V, 250V (connector version 集成连接器);Uimp:6kV, 4kV(connector version 集成连接器);Ith:10A;AC-15;Ue/Ie:400V/3A,250V/4A(AMP connector version AMP 连接器);外壳防护等级:IP67;型号解释见附件

产品标准和技术要求

GB/T14048.5-2017

上述产品符合强制性产品认证实施规则 CNCA-C03-02:2014 的要求, 特发此证。

发证日期: 2019年12月23日 有效期至: 2024年12月23日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书, 证书首次颁发日期: 2007年04月18日

本证书的相关信息可通过国家认监委网站 www.cnca.gov.cn 查询

经中国合格评定国家认可委员会认可 CNAS C001-P



主任:

陆楠



中国质量认证中心



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO.: 2007010305230004

NAME AND ADDRESS OF THE APPLICANT

PIZZATO ELETTRICA S.R.L.
Via Torino.1 36063 Marostica(VI), Italy

NAME AND ADDRESS OF THE MANUFACTURER

PIZZATO ELETTRICA S.R.L.
Via Torino.1 36063 Marostica(VI), Italy

NAME AND ADDRESS OF THE FACTORY

PIZZATO ELETTRICA S.R.L.
Via Torino.2/A 36063 Marostica (VI), Italy

PRODUCT NAME, MODEL AND SPECIFICATION

Position Switch

FA, FB, FF;Ui:400V, 250V (connector version);Uimp:6kV, 4kV(connector version);Ith:10A;A
C-15:Ue/Ie:400V/3A,250V/4A(AMP connector version);IP67;See the appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T14048.5-2017

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO.CNCA-C03-02:2014).

Valid from: Dec.23,2019

Valid until: Dec.23,2024

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Date of original issued: Apr.18,2007

The certificate information is available through CNCA's website: www.cnca.gov.cn

Accredited by China National Accreditation Service for Conformity Assessment CNAS C001-P



President:

Lu Mei



CHINA QUALITY CERTIFICATION CENTRE



中国国家强制性产品认证证书


附录

第 1 页 共 2 页

证书编号: 2007010305230004

纸号: 2501089

型号解释:

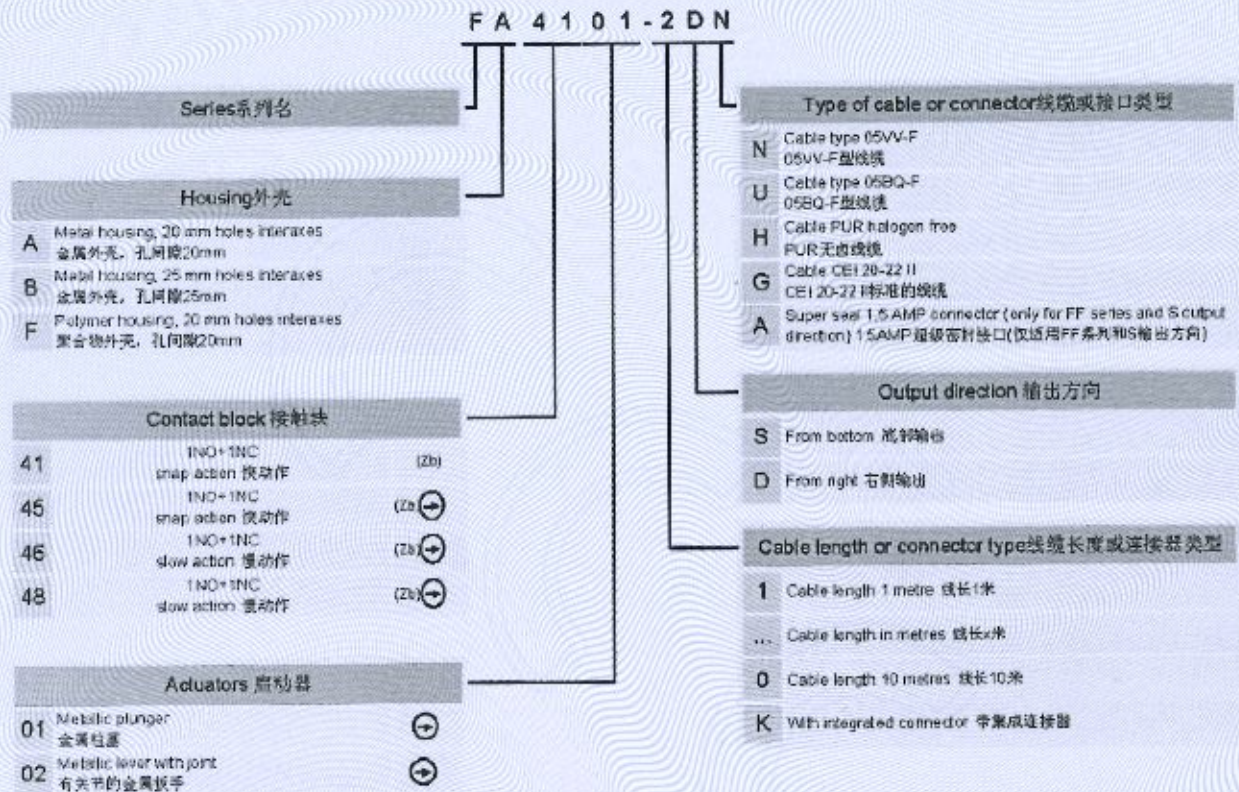

注: 此附录与证书同时使用时有效。



主任: 陆楠



中国质量认证中心



中国国家强制性产品认证证书

附 录

第 2 页 共 2 页

证书编号: 2007010305230004

纸 号: 2501089

- | | | |
|----|--|---|
| 03 | Metallic plunger
金属柱塞 | ⊕ |
| 08 | Metallic plunger with external rubber protection
带橡胶保护的金属柱塞 | ⊕ |
| 10 | Metallic plunger, fixed by the actuator
金属柱塞, 由启动器固定 | ⊕ |
| 11 | Metallic plunger with roller, fixed by the actuator
带滚轮的金属柱塞, 由启动器固定 | ⊕ |
| 12 | Metallic plunger with roller, fixed by the actuator
带滚轮的金属柱塞, 由启动器固定 | ⊕ |
| 13 | As type 12 but rotated of 90 degrees
带滚轮的金属柱塞, 由启动器固定, 可90度旋 | ⊕ |
| 15 | Metallic plunger with roller
带滚轮的金属柱塞 | ⊕ |
| 17 | As type 15 but rotated of 90 degrees
带滚轮的金属柱塞, 可90度旋转 | ⊕ |
| 20 | Spring actuator of stainless steel
不锈钢弹簧启动器 | |
| 25 | Spring actuator of stainless steel
不锈钢弹簧启动器 | |
| 30 | Revolving plastic lever with roller Ø 18 mm
旋转塑料拨手, 带Ø18mm滚轮 | ⊕ |
| 31 | Metallic lever with roller Ø 14 mm
金属拨手, 带Ø14mm滚轮 | ⊕ |
| 33 | Plastic actuator on stainless steel spring
不锈钢弹簧上的塑料启动器 | |
| 34 | Spring actuator of stainless steel on metallic lever
不锈钢弹簧上的金属启动器 | |
| 38 | Only revolving mechanism
仅旋转机构 | ⊕ |
| 40 | Revolving metallic lever with roller Ø 14 mm
旋转金属杆, 带Ø14mm滚轮 | ⊕ |
| 50 | Adjustable stainless steel rod Ø 3x125 mm
Ø3x125 mm可调节不锈钢杆 | |
| 51 | Revolving metallic lever with roller Ø 20 mm
旋转金属杆, 带Ø20mm滚轮 | ⊕ |
| 52 | Revolving metallic lever with roller Ø 20 mm
旋转金属杆, 带Ø20mm滚轮 | ⊕ |
| 53 | Revolving metallic lever with cylindrical ceramic cover
旋转金属杆, 带圆柱形陶瓷罩 | ⊕ |
| 54 | Revolving metallic lever with roller Ø 20 mm
旋转金属杆, 带Ø20mm滚轮 | ⊕ |
| 55 | Revolving metallic adjustable lever with roller Ø 20 mm
旋转金属可调杆, 带Ø20mm滚轮 | ⊕ |
| 56 | Revolving metallic adjustable lever with roller Ø 20 mm
旋转金属可调杆, 带Ø20mm滚轮 | ⊕ |
| 57 | Revolving metallic lever with roller Ø 20 mm
带Ø20mm滚轮的旋转金属杆 | ⊕ |
| 69 | Adjustable rod Ø 6x200 mm
Ø6x200mm可调节杆 | ⊕ |

NOTE: "positive opening" mark on the product if and only if both the following requirements are met: the actuator must be a positive opening one and the internal contact unit must be positive opening. 备注: 只有当启动器和触头都将直接断开功能时, 开关才适用直接断开

注: 此附录与证书同时使用时有效。



主任: 陆楠



中国质量认证中心